


» Generator set data sheet

Model: C2000 D5
Frequency: 50
Fuel Type: Diesel

| | |
|---|-----------------------|
| Spec sheet: | SS17-CPGK |
| Noise data sheet (Open/enclosed): | ND50-OSHHP/ND50-CSHHP |
| Airflow data sheet: | AF50-HHP |
| Derate data sheet (Open/enclosed): | DD50-OSHHP/DD50-CSHHP |
| Transient data sheet: | RTF |

| Fuel consumption | Standby | | | | Data Center Continuous | | | |
|-------------------------|-----------------|------------|------------|-------------|-------------------------------|------------|------------|-------------|
| | kVA (kW) | | | | kVA (kW) | | | |
| Ratings | 2063 (1650) | | | | 1875 (1500) | | | |
| Load | 1/4 | 1/2 | 3/4 | Full | 1/4 | 1/2 | 3/4 | Full |
| gph | 26.2 | 44.6 | 64.2 | 86.4 | 24.4 | 41.1 | 58.7 | 78.0 |
| L/hr | 119.00 | 203.00 | 292.00 | 393.00 | 111.00 | 187.00 | 267.00 | 355.00 |

| Engine | Standby rating | Data Center Continuous |
|--------------------------------|--|-------------------------------|
| Engine manufacturer | Cummins | |
| Engine model | QSK60-G3 | |
| Configuration | Cast Iron, 60° V16 Cylinder | |
| Aspiration | Turbo Charged and Low Temperature After-Cooled | |
| Gross engine power output, kWm | 1789 | 1614 |
| BMEP at set rated load, kPa | 2386 | 2158 |
| Bore, mm | 159 | |
| Stroke, mm | 190 | |
| Rated speed, rpm | 1500 | |
| Piston speed, m/s | 9.5 | |
| Compression ratio | 14.5:1 | |
| Lube oil capacity, L | Stdby 280 Prime/Cont 397 | |
| Overspeed limit, rpm | 1850 ±50 | |
| Regenerative power, kW | 146 | |
| Governor type | Electronic | |
| Starting voltage | 24V Volts DC | |

| Fuel flow | |
|---------------------------------------|------|
| Maximum fuel flow, L/hr | 1893 |
| Maximum fuel inlet restriction, mm Hg | 203 |
| Maximum fuel inlet temperature (°C) | 71 |

| Air | Standby rating | Data Center Continuous |
|--------------------------------------|-----------------------|-------------------------------|
| Combustion air, m ³ /min | 139.00 | 125.00 |
| Maximum air cleaner restriction, kPa | 6.2 | |

| Exhaust | | |
|---|-----|-----|
| Exhaust gas flow at set rated load, m ³ /min | 320 | 295 |
| Exhaust gas temperature, °C | 477 | 452 |
| Maximum exhaust back pressure, kPa | 6.7 | |

| Standard set-mounted radiator cooling | | |
|---|------|-----|
| Ambient design, °C | 40 | |
| Fan load, KW _m | 29.1 | |
| Coolant capacity (with radiator), L | 454 | |
| Cooling system air flow, m ³ /sec @ 12.7mmH ₂ O | 26.4 | |
| Total heat rejection, BTU/min | RTF | RTF |
| Maximum cooling air flow static restriction mmH ₂ O | 0.12 | |


| Weights* | Open | Enclosed |
|---------------------|-------------|-----------------|
| Unit dry weight kgs | 14649 | N/A |
| Unit wet weight kgs | 15152 | N/A |

* Weights represent a set with standard features. See outline drawing for weights of other configurations


| Dimensions | Length | Width | Height |
|----------------------------------|---------------|--------------|---------------|
| Standard open set dimensions | 6175.1 | 2286 | 2537.2 |
| Enclosed set standard dimensions | N/A | N/A | N/A |

Genset outline

Open set

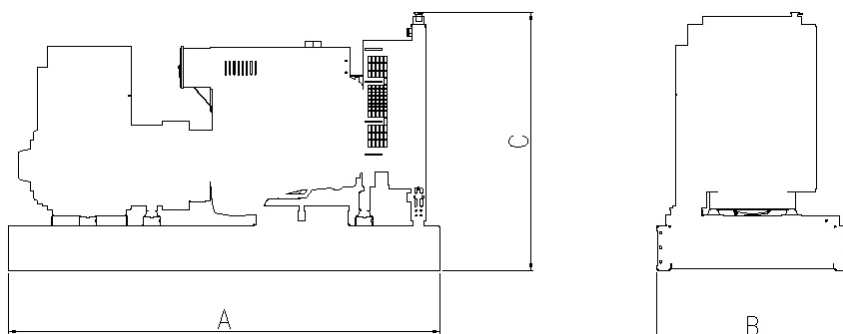

Enclosed set

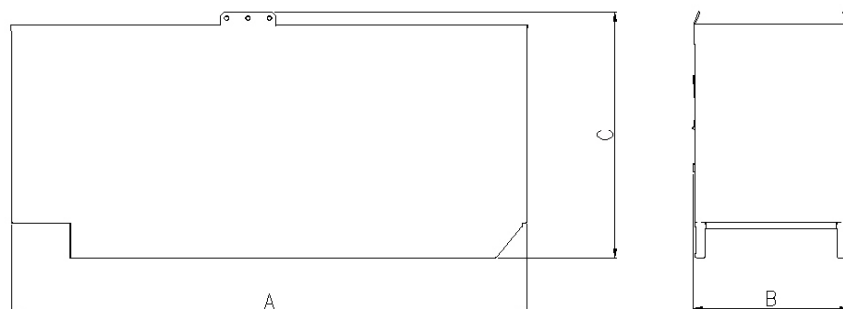

Outlines are for illustrative purposes only. Please refer to the genset outline drawing for an exact representation of this model.

Alternator data

| Connection ¹ | Temp rise °C | Duty ² | Alternator | Voltage |
|-------------------------|--------------|-------------------|------------|------------|
| Wye, 3 Phase | 105/80C | S/P | MVSI804R1 | 1905/3300V |
| Wye, 3 Phase | 125/80C | S/P/C | HVSI804R1 | 6300-6600V |
| Wye, 3 Phase | 125/80C | S/P/C | HVSI804R1 | 11000V |
| Wye, 3 Phase | 150/105C | S/P/C | LVP7F | 380-440V |
| | | | | |
| | | | | |

Ratings definitions

| Emergency Standby Power (ESP) | Limited-Time running Power (LTP): | Prime Power (PRP) | Data Center Continuous Power (COP) |
|--|--|---|---|
| Applicable for supplying power to varying electrical load for the duration of power interruption of a reliable utility source. Emergency Standby Power (ESP) is in accordance with ISO 8528. Fuel Stop power in accordance with ISO 3046, AS 2789, DIN 6271 and BS 5514. | Applicable for supplying power to a constant electrical load for limited hours. Limited Time Running Power (LTP) is in accordance with ISO 8528. | Applicable for supplying power to varying electrical load for unlimited hours. Prime Power (PRP) is in accordance with ISO 8528. Ten percent overload capability is available in accordance with ISO 3046, AS 2789, DIN 6271 and BS 5514. | Applicable for supplying back-up power for data center applications evaluated at specific site conditions. This rating is based on load profiles and performance requirements consistent with the data center industry. This rating is site specific and changes in application type or location would require further consideration. |

Formulas for calculating full load currents:

Three phase output

$$\frac{kW \times 1000}{\text{Voltage} \times 1.73 \times 0.8}$$

Single phase output

$$\frac{kW \times \text{Single Phase Factor} \times 1000}{\text{Voltage}}$$

See your distributor for more information.

Cummins Power Generation
 Manston Park, Columbus Avenue
 Manston, Ramsgate
 Kent CT12 5BF, UK
 Telephone: +44 (0) 1843 255000
 Fax: +44 (0) 1843 255902
 E-Mail: cpg.uk@cummins.com
 Web: www.cumminspower.com